


Leak detection technology

For a clean and protected environment



Pressure leak detector DL 330 ELC FCM

with integrated dry filter control FC and digital pressure display M



Leak detector DL 330 ELC FCM



Manifold for a quick and easy function test of the system without access to the tank. The connection for tubing is available in different types (e.g. quick ferrule union.)



Leak indicating unit LAE

For the monitoring up to 6 double walled tanks. With integrated drying filter sensor to avoid condensation and corrosion in the interstitial space. The sensor will indicate an unacceptable level of humidity due to saturated drying material. By this, the notice for changing the dry filter material will be guaranteed and a main important contribution for a long term run of the tank is done. In addition, with digital pressure display M (manometer) that indicates the current pressure of the system.

A sensor is integrated in the suction line of the pump between pump and dry filter to measure the moisture of the air intake. The sensor registers the increase in relative humidity when the desiccant is spent. The optical and audible alarm is triggered together with the potential-free message when the drying capacity is insufficient. The visual indication consists of alternate flashing of the two red alarm LED's.

The leak detector DL 330 ELC FCM is the optimal alternative if high integration and low use of space is required. The monitoring system for tanks and pipes may be integrated into one system. The working unit can be installed outside without additional requirements. The indication unit offers the optical and audible alarm inclusive a dry relay contact for alarm transmitting.

- **Small, space saving design**
- **Little installation efforts**
- **Weather proof design of the leak detector**
- **Separate alarm indication for tanks and pipes**
- **Dry filter control FC**
- **Digital pressure display M (manometer)**

Every leak in one of the walls will be detected by an optical and audible alarm before product enters the environment. Integrated valves allow for quick localisation of a leaking tank. A supreme class I leak detection system in accordance to the European standard EN 13 160.

For the monitoring of:

Double walled cylindrical underground tanks with a test pressure of the interstitial space of minimum 500 mbar (e.g. in accordance with DIN 6608/2)


Liquids to be monitored:

Water polluting liquids, e.g. petrol, diesel, heating oil, lye, acid

Alarm pressure	> 330 mbar
Operating pressure	< 410 mbar
Max. pressure on tank bottom	300 mbar
Min. test pressure in interstice	500 mbar

Leak detection technology

For a clean and protected environment



Pressure leak detector DL 330 ELC FCM

Monitoring principle:

The pump in the leak detector creates a fixed operational overpressure in the interstitial space. This is shown permanently by the digital pressure display M (manometer). In case of a leak, the compressed air will escape through the leak. This prevents product or groundwater entering the interstitial space. Any minor unavoidable untightness is compensated by the system automatically. If the volume flow of air escaping from the interstitial space is higher than the limited volume flow of the pressure pump, the pressure

will drop to the alarm pressure. An optical and audible alarm will be released.

The compressed air in the interstitial space is dried by the dry filter mounted to the leak detector. Therefore, a condensation of water in the interstitial space is prevented.

An overpressure valve avoids the occurrence of an inadmissible overpressure in the interstitial space.

Installation advice:

The leak detector shall not be installed in hazardous classified areas.

Outside closed and dry rooms, the indicating unit has to be installed in a suitable protection box.



Colored, flexible or rigid tubes are to be used as a connection between leak detector and interstitial space.

Useful fittings on the leak detector guarantee a quick and safe examination of the functions.

Additional alarm signal units can be connected directly to the leak detector. Dry relay contacts for alarm transmitting are included.

When operating, installing and commissioning the leak detector DL 330 ELC FCM, the conditions laid down in the approvals for the leak detector, tanks and linings are to be observed.

All works shall be carried out by a qualified person.

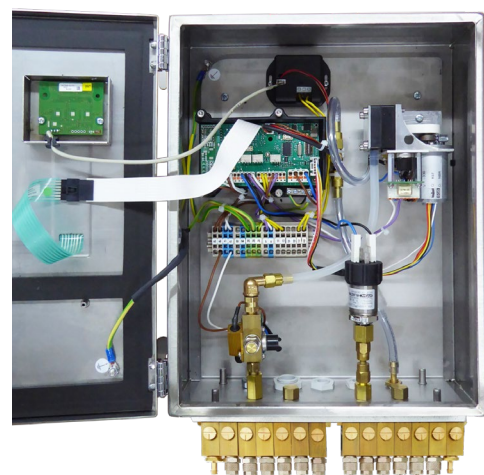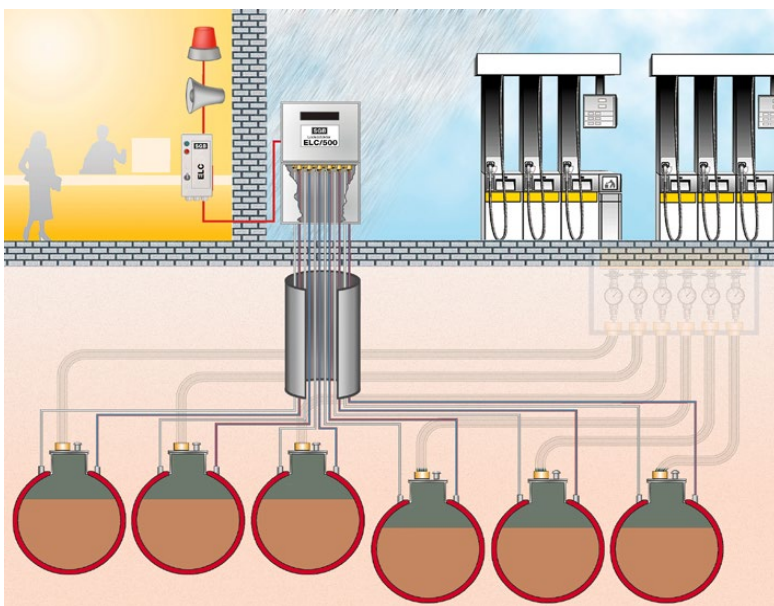

Helpful accessories allow an easy and quick test of the system without entering the manhole chamber.