# **Options and accessories VLXE .. M:**



**Service Indication Si** Time intervals for maintenance are adjustable from 1 up to 63 months.



# **Hood for housing**

Extra protection for the leak detector against weather conditions in case of outside installation. Material: stainless steel 1.4301 Dimensions: 348 x 365,5 x 250 mm Art.no.: 412261

#### **Technical data**

# **General data**

Weight:

8,3 kg -40 °C-+60 °C Operational temperature range: Sound volume buzzer: > 70 dB(A) in 1 m Protection class:

Max. height for safe operation: ≤ 2000 m NN Max. relative humidity for safe op.: 95 %

Ex data (ONLY pneumatic part)

#### **Electrical data**

Power supply: - optional:

Power consumption: Terminals 5,6 external signal: Terminals 11 ... 13 (voltage free):

Terminals 17 ... 19 (voltage free):

100 to 240 V, 50-60 Hz 24 V DC

50 W (including heating) max. 24 V DC, max. 300 mA  $DC \le 25 \text{ W or AC} \le 50 \text{ VA}$  $DC \le 25 \text{ W or AC} \le 50 \text{ VA}$ 

max. 10 A, 1500 A breaking capacity

⟨Ex⟩ II 1/2G Ex c IIB3 T4 Ga/Gb

**Switching values VLXE .. M** 

Туре	Alarm ON, at the latest	Pump OFF, not more than	Vacuum operability interstitial space ≥
34*	34 mbar	100 mbar	250 mbar
80*	80 mbar	140 mbar	400 mbar
230	230 mbar	360 mbar	650 mbar
255	255 mbar	380 mbar	650 mbar
330	330 mbar	450 mbar	700 mbar
410	410 mbar	540 mbar	750 mbar
500	500 mbar	630 mbar	850 mbar
570	570 mbar	700 mbar	900 mbar

<sup>\*</sup> Only with suction line to the deep point of the interstitial space



Imprint

### SGB GmbH

Hofstr. 10 57076 Siegen Germany +49 271 48964-0 sgb@sgb.de shop.sgb.de/en

# Pictures and schemes are not binding for the extent of delivery. All information subject to change. 02/2025, © SGB GmbH

# LEAK PREVENTION TECHNOLOGY

For a clean and protected environment








# Vacuum leak detector VLXE .. M – More safety handling hazardous liquids

The leak detectors VLXE .. M monitor unpressurized double-walled tanks and pipes. VLXE .. M is a leak detection system with a basic explosion protection to be mounted outside Ex areas. With its partially explosion-proof design, ethanol-containing fuels can also be monitored. Its full electronic equipment is unique.

Vacuum
leak detectors
VLXE .. M meet the
highest environmental
protection and safety
requirements of
EN 13160,
class I.

Due to the safe and continuous monitoring each leak will be reliably indicated – regardless whether the leak is in the inner or outer wall. And this *before* any stored or transported liquid can enter the environment!


### THE NEW TECHNICAL STANDARD

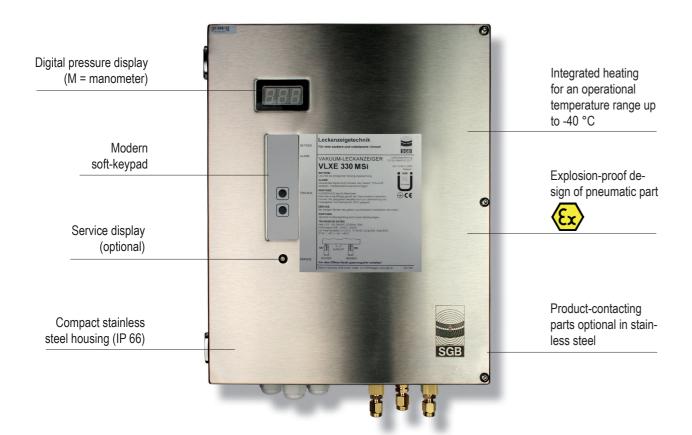


# Your advantages & high ease of use

- One-piece housing for lateral opening
- Microprocessor controlled data logging
- · Digital pressure display "M"
- Automatic calculation and display of the tightness of the entire monitoring system
- Insensible soft-keypad that is completely tight integrated into the housing's surface
- Designed for outdoor installation (stainless steel housing with IP 66)
- Multirange power supply: 100–240 V AC or optional 24 V DC
- Fully electronic
- Resistant to many liquids through brass or stainless steel version
- · Potential-free relay contacts are standard


## Installation examples – installation of the LEAK DETECTOR ALWAYS OUTSIDE ex-area




► Tank with lining or double-walled steel tank

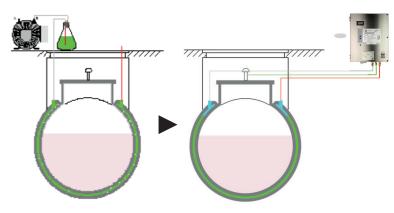

► Change over from liquid leak detection to vacuum monitoring



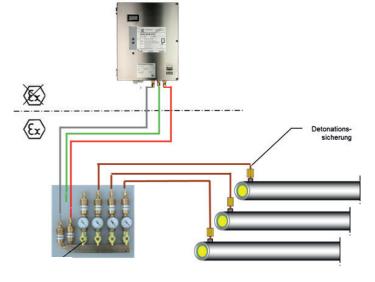

Vertical cylindrical tank

Pipes

#### Monitorable tanks

Tanks with max. 50 mbar overpressure, e. g. due to vapour recovery lines, for liquids with a flash point  $\leq$  60 °C (Germany  $\leq$  55 °C) are considered to be unpressurized. This may be e. g.:

- Single-walled horizontal cylindrical tanks with lining or jacketing
- · Double-walled horizontal cylindrical tanks
- Double-walled or single-walled tanks with lining or jacketing vertical cylindrical tanks or sumps with dished bottoms
- Rectangular or cylindrical tanks or sumps with flat bottoms (completely double-walled or with lining or jacketing)

#### Monitorable pipes

Double-walled sufficiently pressure resistant (interstitial space must be sufficiently pressure resistant!) pipes and fittings made of metal or plastic in factory or on-site construction.

Installation kits
for connecting
the leak detector
are available from stock
for all common pipe
manufacturers.

# Monitorable liquids

Water-polluting liquids for which the design of the leak detector in brass or stainless steel is considered sufficiently resistant. Occurring vapour-air-mixtures must be heavier than air as well as classifiable in gas group IIA up to IIB3 and temperature code T1 up to T3, like gasoline, diesel, AdBlue for example.

If different water-polluting liquids are conveyed in single pipelines, these should be monitored with several leak detectors for safety reasons. Thus, possible impurities or unwanted chemical reactions can be reliably avoided.

Monitoring hazardous liquids: If the flash point of the liquid (≤ 60 °C, Germany ≤ 55 °C) to be monitored requires explosion protection measures

the VLXE .. M can only be used on

- pressureless tanks (no flat-bottom tanks, no vertical tanks)
- pressureless pipes,
   e. g. filling or suction lines.